

# FIELD INSPECTION PROCEDURE

## BREAK-SAFE® 600 Load Break & Pick-up Tool

Follow the steps below before EACH use of the BREAK-SAFE® 600.  
This procedure does NOT replace or eliminate periodic maintenance.

USBS-600-1

PATENT NO. 6,078,008 Other Patents Pending

### 1. VISUAL INSPECTION

Visually inspect the tool. If any of the following are found, remove the tool from the field and perform service:

- Soot or Dirt buildup on components
- Damaged Load Break Ring. Ring should rotate freely (shaft should NOT rotate)
- Damaged or discolored Yellow Tube
- Damaged Conductor Hook
- Loose Conductor Bars
- Damaged Safety Locking Pin
- Out of Date Maintenance Decal (service should be performed within 2 years of date shown)

### 2. CONTINUITY


A current path will exist inside the tool until the load break mechanism is triggered.

**Test both Conductor Bars.**

**A)** With the tool in the CLOSED position, use a voltmeter, confirm continuity exists between a Conductor Bar and the Conductor Hook.

**B)** Confirm continuity exists while pulling the Load Break Ring toward the open position. Continuity should exist until the load break mechanism is engaged and the tool locks in the open position.

**C)** Confirm NO continuity exists between a Conductor Bar and the Conductor Hook when the tool is in the fully opened positioned.

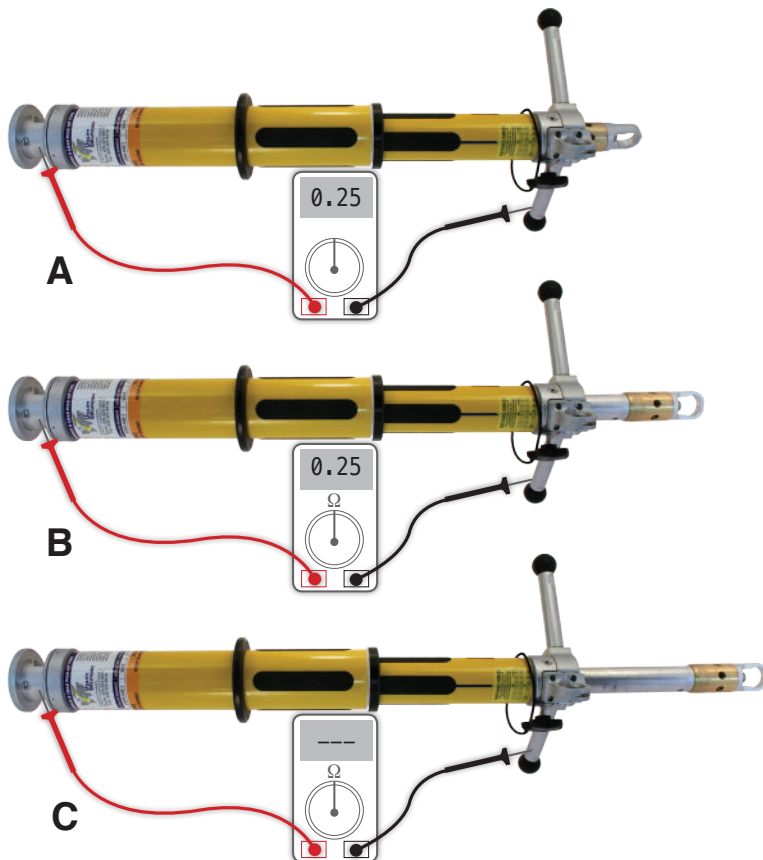


### 3. SAFETY RESET

The BREAK-SAFE® will reset when the Load Break Ring Assembly has fully retracted inside the tool.

Exert a steady downward movement on the Load Pick-up Trigger (**D**). The Load Break Ring Assembly should retract forcefully into the tool.

**Push the Load Break Ring up into the tool firmly to reset (E).**

An internal safety mechanism will not allow the Load Break Ring to extend until the tool has been reset. The tool will require service and should NOT be used if the Load Break Ring cannot extend after resetting.

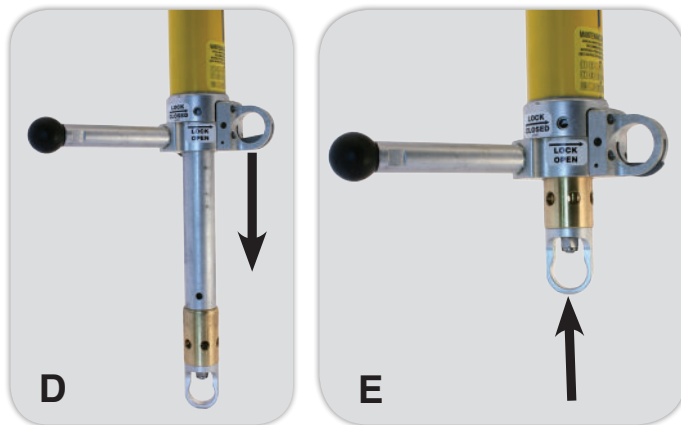

#### WARNING



Carefully read and fully understand the manual prior to operating, maintaining or testing this device. Improper operation, handling or maintenance of this device can result in death, grievous personal injury and or equipment damage.

Phone (828)323-8914

Fax (828)323-8410

Email [sales@utilitysolutionsinc.com](mailto:sales@utilitysolutionsinc.com)

Web [www.utilitysolutionsinc.com](http://www.utilitysolutionsinc.com)

101 33<sup>rd</sup> Street Drive SE · Hickory, NC 28602

C-01051


USBS-600-1 Field Inspection (2-24-16)

Copyright © 2016 Utility Solutions, Inc.

  
**UTILITY  
SOLUTIONS**  
*Lineman driven. Field proven.®*

# FIELD INSPECTION PROCEDURE

## BREAK-SAFE® 600 Load Break & Pick-up Tool

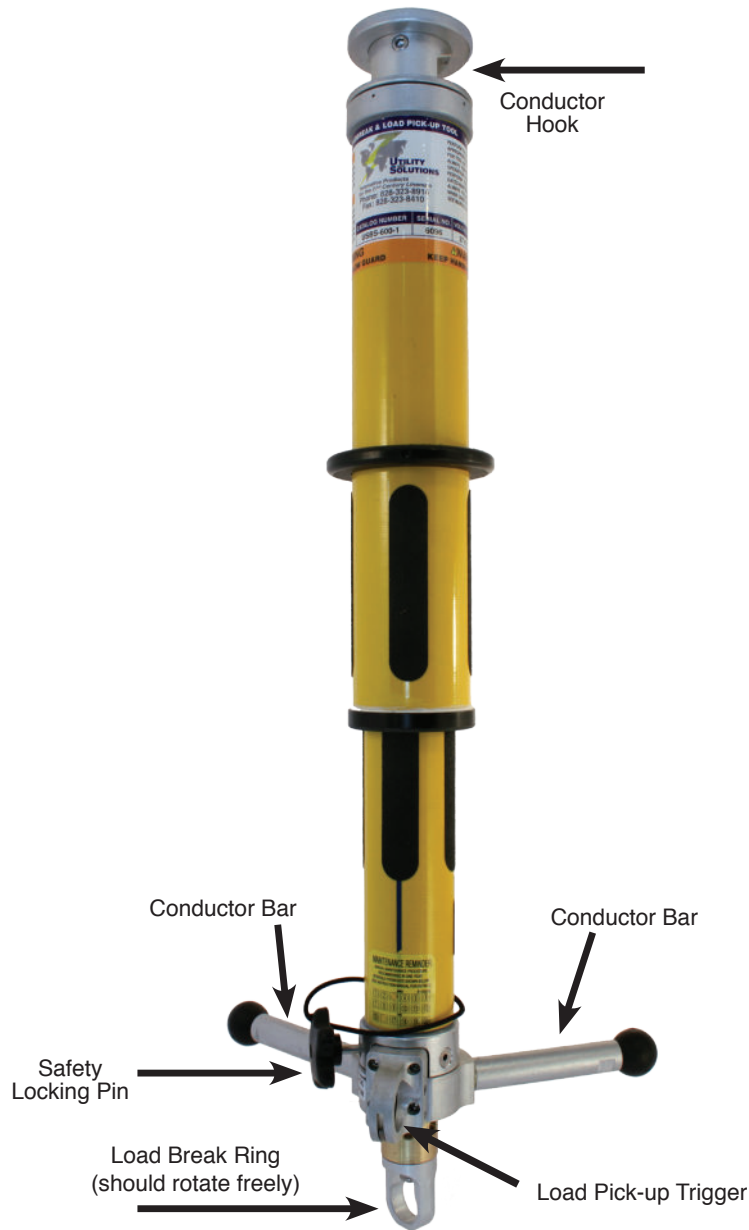

### WARNING



Always remove the BREAK-SAFE® 600 from the circuit, or remove the jumpers attached to the conductor bars, after each load break operation.

The BREAK-SAFE® 600 is not rated insulation nor is it considered a “visible gap”.




### DANGER



Refer to Inspection Procedure on reverse side and the Operation Manual for complete instructions on properly resetting the BREAK-SAFE® 600.

# LOCKED

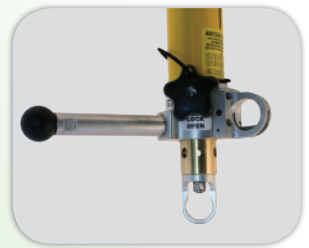


CLOSED



OPEN

# UNLOCKED

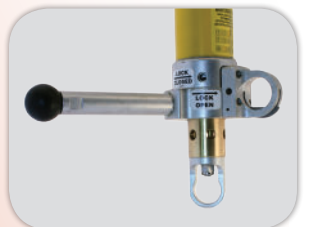

CLOSED



OPEN

Phone (828)323-8914  
 Fax (828)323-8410  
 Email [sales@utilitysolutionsinc.com](mailto:sales@utilitysolutionsinc.com)  
 Web [www.utilitysolutionsinc.com](http://www.utilitysolutionsinc.com)  
 101 33<sup>rd</sup> Street Drive SE · Hickory, NC 28602

C-01051  
 USBS-600-1 Field Inspection (2-24-16)  
 Copyright © 2016 Utility Solutions, Inc.

 **UTILITY  
SOLUTIONS**  
*Lineman driven. Field proven.®*